



Luminaire Schedule		Qty	Label	Arrangement	LLF	Description	Total Watts	Lumens/Lamp
●	10	A	BACK-BACK	0.930	ARE-EDR-5M-AA-04-D-UL-BZ-ML	1400	5635	
●	5	A1	SINGLE	0.930	ARE-EDR-5M-AA-04-D-UL-BZ-ML	350	5635	

\*\*\*\*\*Existing pole\*\*\*\*\*  
 Fixture Mounting Height: 27' afg  
 Mounting arm length: 4'

Calculation Summary					
Label	Units	Avg	Max	Min	Avg/Min
Parking lot	Fc	0.75	1.5	0.0	N.A.

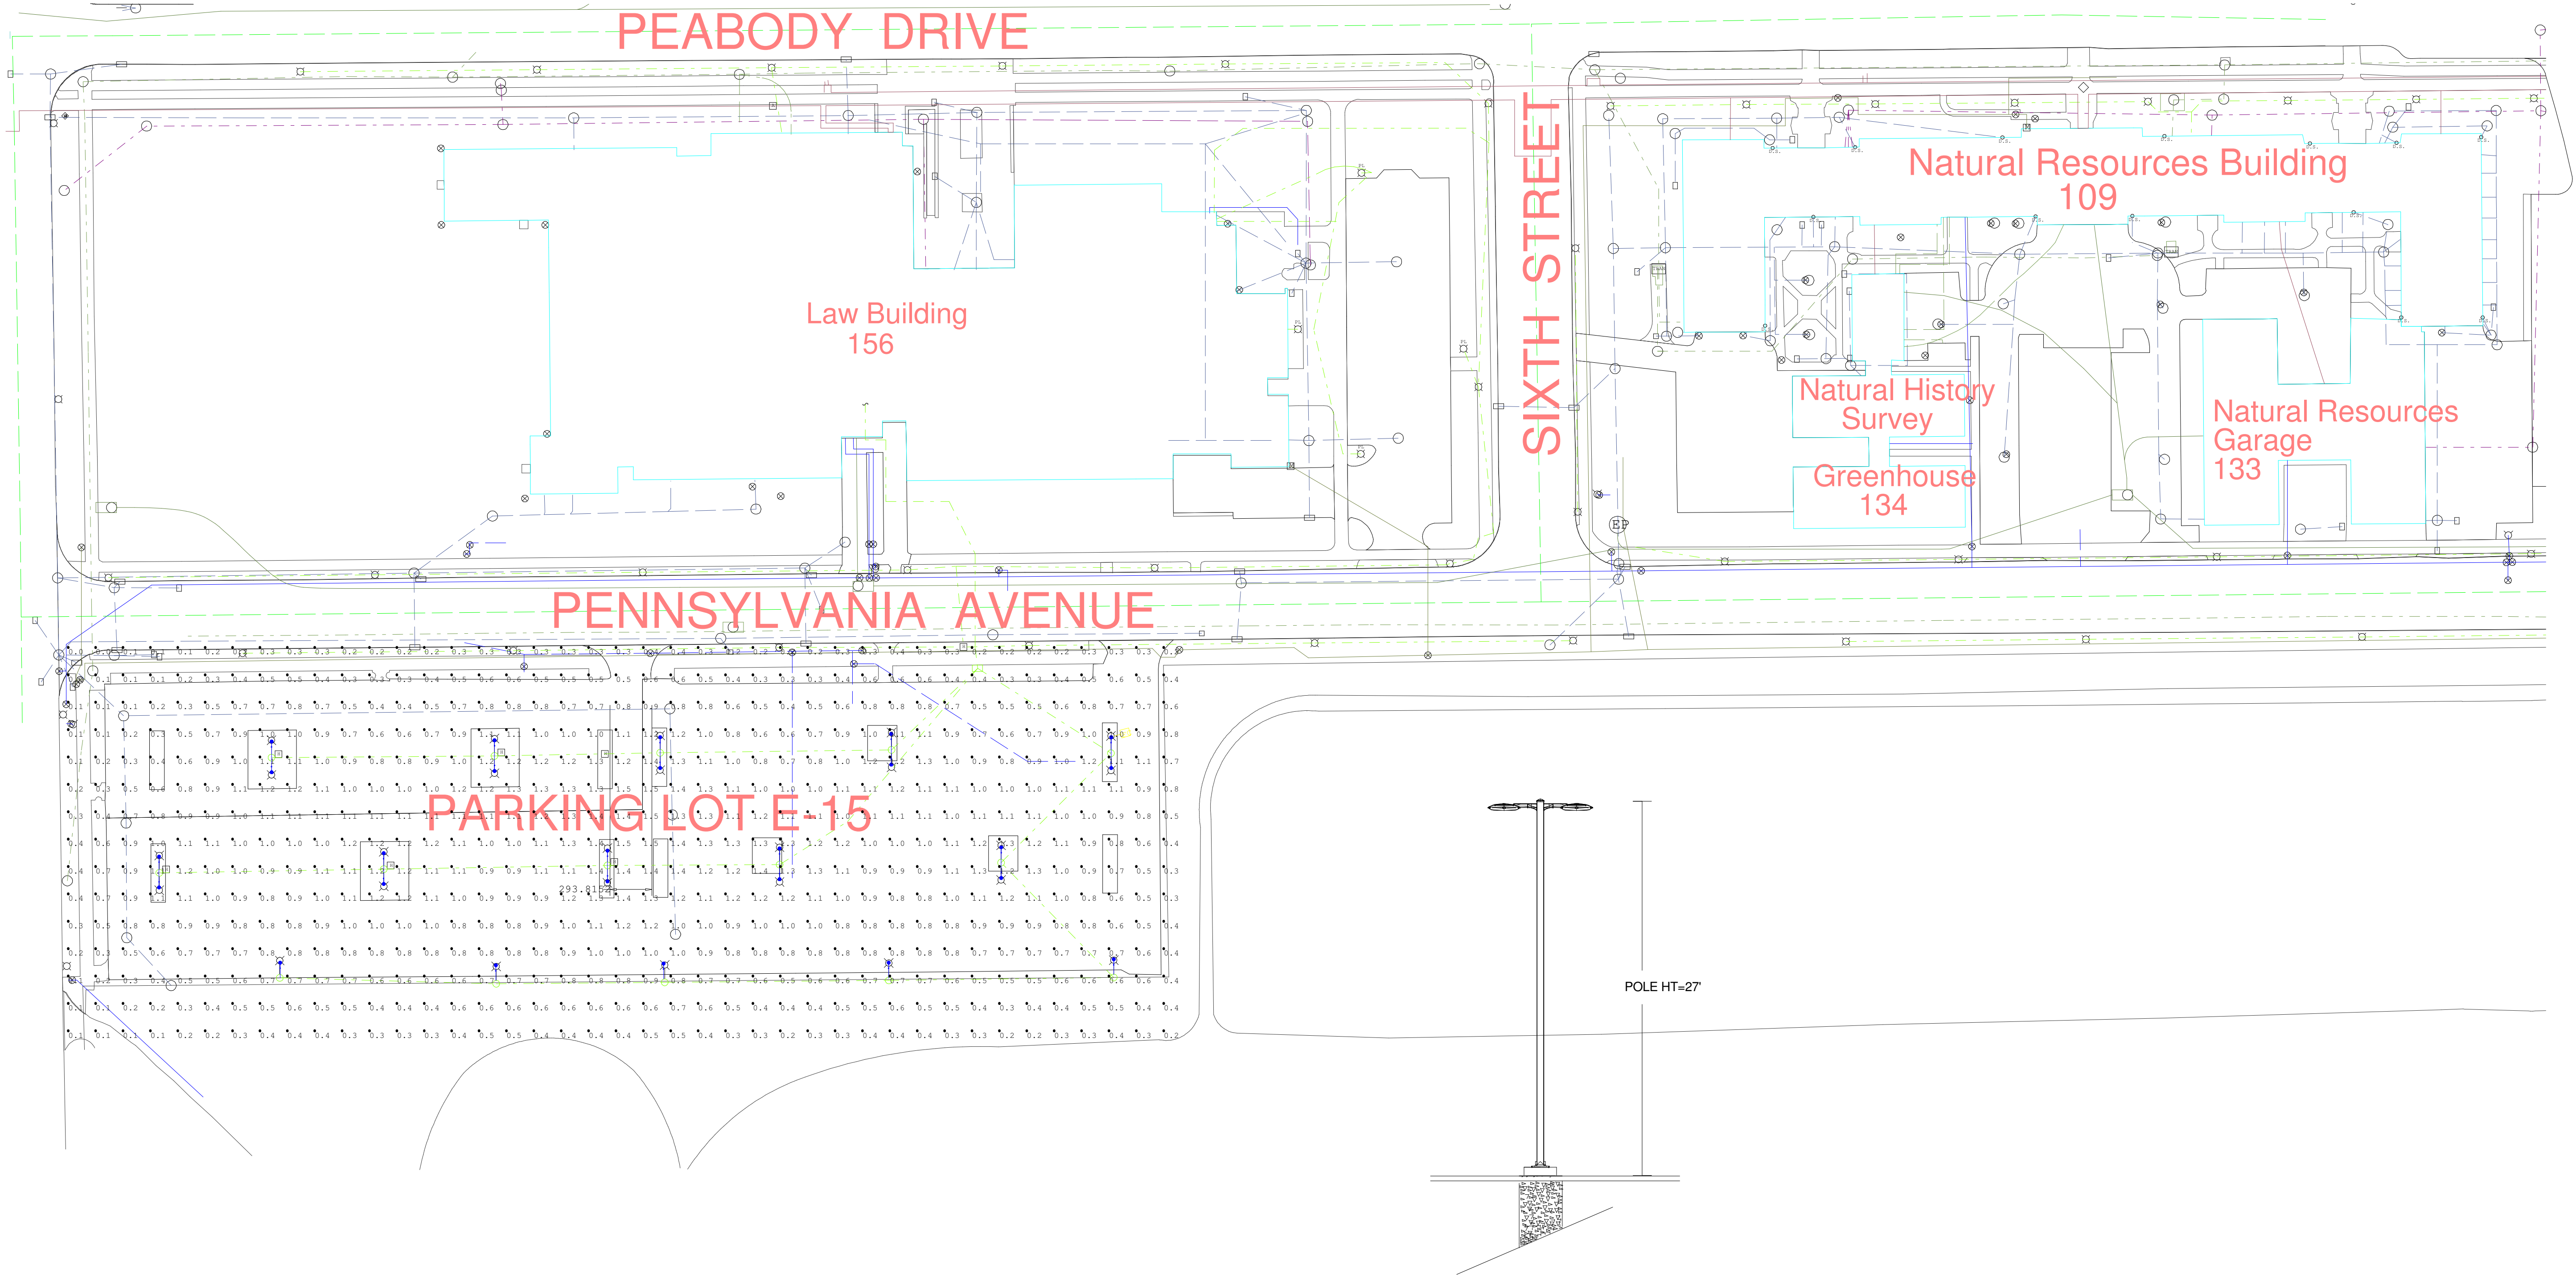

Project Name: Parking Lot E-15 Customer No: 01872  
 Date: 10/18/2012 Scale: 1"=50' photocard calculated at grade using predicted lumen values after 50K hours of operation  
 Filename: 121015MA1TNGR1.AGI Layout by: Tiffany Gentry

Illumination results shown on this lighting design are based on project parameters provided to Cree, Inc. used in conjunction with luminaire test procedures conducted under laboratory conditions. Actual project conditions differing from these design parameters may affect field results. The customer is responsible for verifying dimensional accuracy along with compliance with any applicable electrical, lighting, or energy code.